Koopman International B.V.

Distelweg 88
1031 HH Amsterdam
The Netherlands
Tel. : +31 20 4947783
Fax : +31 20 6366131
Email: qc@koopmanint.com

Date: 2022-08-25

Report number: CY5952050-070168-1 - LEAKAGE



Tested according to: IN HOUSE METHOD

Conclusion: PASSED

Tested by: Jan van Vlaanderen

Applicant:	Koopman International
Country:	The Netherlands
Sample Description:	FOLDABLE WATER CONTAINER 20L
Item number:	CY5952050
Order number:	070168
EAN code:	8720573507431

The test results only apply to the tested specimens.
Signed for and on behalf of Koopman International B.V.

Koopman International B.V.
Distelweg 88
1031 HH AMSTERDAM
Tel. (+31)20-4947777 / Fax (+31)20-6366131

Ir. Ing. E. Ramadan
Chemist & Technologist.

Koopman International BV has a verified Bureau Veritas procedure of
Laboratory Testing and a Bureau Veritas verification of REACH compliance.
The test itself and the associated report is reviewed by Koopman International BV.

BUREAU VERITAS 1828

Test Results

Description	Details		
	result	spec rule	specification
WHOLE ARTICLE for LEAKAGE			
Leakage	Passed	Not Equal to	Failed

Pictures taken during testing:



Article as received

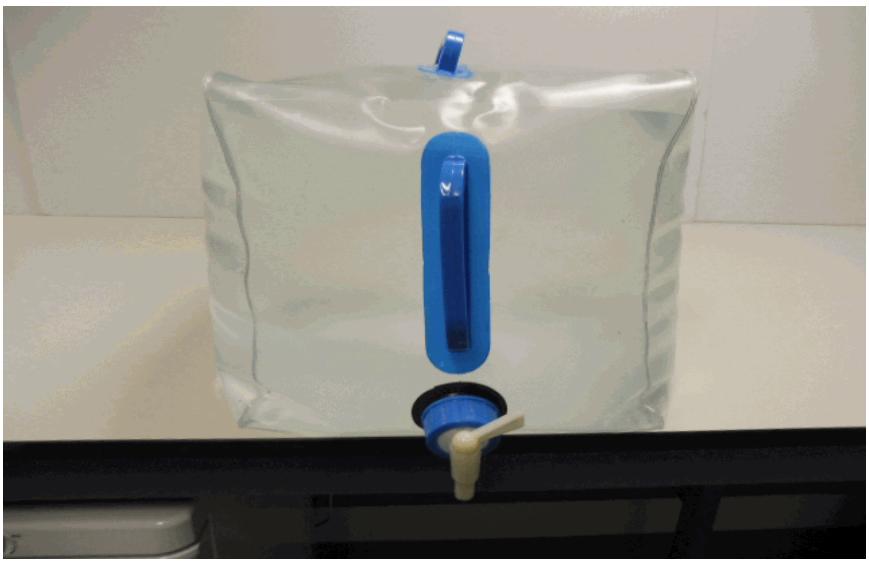

Article filled with water

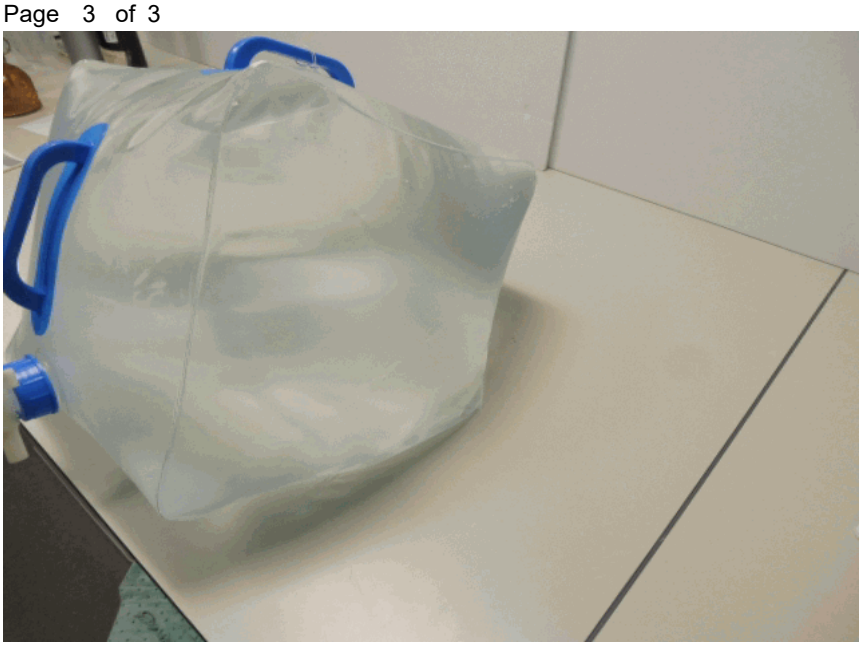

Side view

*** END OF REPORT ***

Koopman International BV has a verified Bureau Veritas procedure of
Laboratory Testing and a Bureau Veritas verification of REACH compliance.
The test itself and the associated report is reviewed by Koopman International BV.